Clevertest and Clevertest Plus 💥

Refer to the supplementary operation guide supplied with the Product.

After Power ON, the Status LED on a Clevertest Plus enabled fitting will display a rapid Green or Red flashing for a period up to 2 minutes.

Zoneworks, HIVE (HV/HVG) and DATA Monitored Options

Fittings with part numbers -ZW, -HV, -HVG, -DATA are fitted with Zoneworks communications modules (nodes). These fittings are monitored using either Powerline Carrier Technology that utilize the power cable to provide data communication, RF transceiver modules operating in the ISM band or a dedicated data cable to/from data routers installed on a dedicated data trunk connected to a central Server (can also be connected via Ethernet/Internet/Fibre). Zoneworks software on the server is used to monitor, coordinate testing and collate test data from each fitting. Zoneworks Fittings can be commissioned by a single push of the test switch or by scanning the supplied barcode. The LED Test Switch indicator provides a multifunction indication of the status of the fitting during testing and normal operation:

Option	State	LED Operation
ZW, HV, HVG, DATA	Commissioned	LED on Solid (Green)
ZW, DATA	Un-commissioned	Batt plugged-in: yellow 1s, green 1s
		Batt unplugged: red 1s, off 1s
HV, HVG	Un-commissioned	Batt plugged-in: yellow 1s, green 1s
	With network connectivity	Batt unplugged: red 1s, off 1s
HV, HVG	Un-commissioned Without network connectivity	Batt plugged-in: yellow 250mS, green 250mS, yellow 250mS, green 250mS, green 1s
		Batt unplugged: red 250mS, off 250mS, red 250mS,off 250mS, off 1s
ZW, DATA	Emergency Light Test In Progress	LED flashes at yellow 5s , 0ff 1s
HV, HVG	Emergency Light Test In Progress	LED flashes at yellow 1s , 0ff 1s

In the case of the DATA version a 2-way "figure 8" cable and terminal block facilitates the connection to the DATA network via a multi-drop bus (daisy chain connection). For further information of installation of a Zoneworks system, please refer to the Zoneworks Users Guide and Commissioning Guide (incl. DATA version)

DALI EM Option

Luminaires with part numbers having -DALI are fitted with DALI modules (nodes) that facilitate connection and integration to 3rd Party Lighting Control Systems. Before installing the -DALI luminaire, please confirm that the Lighting Control System has the capability to monitor DALI Emergency Luminaires. The -DALI fitting will be addressed and configured into the control system by the Lighting Control System Commissioning Technicians and not Clevertronics.

State	LED Operation
Commissioned/ Un-commissioned	LED on Solid (Green)
Emergency Light Test in progress	LED flashes at 1s On (Yellow) & 1s Off
"IDENTIFY COMMAND"	Lamp and Status LED Flash for 30 seconds

A 2-way "figure 8" cable and terminal block facilitates the connection to the DALI network. DALI connections are marked as Da Da.





L10[™] Supalite LED Weatherproof Emergency Luminaire

Installation & Maintenance Instruction Leaflet



Designed in Australia to comply with the requirements of AS2293.3: 2005 and AS/NZS CISPR15: 2017 NOTE: Standard product codes with this symbol are enabled with Clevertest Plus capability. Please refer to the operation guide supplied with the product for details.

Models: Testing:	LWFLED-xx-yy
Manual Test	xx = Blank
Zoneworks	xx = ZW
Z/W DATA	xx = DATA
Zoneworks HIVE	xx = HV/HVG
DALI Registered.	XX = DALI
Clevertest	xx = CT

(NOTE: -CT Products supplied with the Clevertest Plus Symbol $\frac{1}{2}$ are activated with Clevertest PLUS capability. Please refer to the operation guide supplied with the product for details).

Spare Parts:

Replacement Battery
Replacement Emergency LED Board
Replacement Emergency Driver
Replacement Emergency Driver (-HV)
Replacement Emergency Driver (-HVG)
Replacement Emergency Driver (-DALI)

Important:

It is illegal for anyone, except for a licensed electrician to install or maintain this product. Before installation, ensure that the electricity supply has been switched off and isolated. Installation must be carried out in accordance with the relevant Australian and International Standards.

Victoria (Head Office & Manufacturing) Website: www.clevertronics.com.au Email: info@clevertronics.com.au Phone: +61 3 9559 2700 Fax: +61 3 9559 2799

New South Wales

Phone: +61 2 8805 6400 **Fax:** +61 2 8805 6444

Queensland

Phone: +61 7 3442 9700 Fax: +61 7 3442 9777

South Australia/Northern Territory

Phone: +61 8 8301 8800 **Fax:** +61 8 8351 8286

Western Australia

Phone: +61 8 9207 0000 Fax: +61 8 9207 0088

New Zealand Phone: +64 800 548 448

Options:

Colour, Black yy = BLK

Instruction Sheet Template - V1.3 – Updated 20/01/2022

Installation:


The L10 Weatherproof Supalite (LWFLED) is Wall Mounted. The LWFLED is housed in a weatherproof enclosure. The enclosure base is attached to the wall using screws installed through the 4 isolated holes. Once the base is mounted and wired the gear tray and cover are installed. Please follow the steps below to install the Weather Proof Exit:

- Remove the enclosure cover.
- Remove the gear tray.
- Determine power entry.
- Drill power access hole in the box base.
- Position the box base in the mounting position.
- Mark the 4 holes for mounting. Install the base using appropriate fixings (not supplied).
- Connect the 240VAC supply to the terminal block on the Gear Tray.
- Reinstall the gear tray.
- Reinstall the enclosure cover.
- If the CTP capabilities are activated, please affix the CTP status label to a visible surface and Four Segment Marking on the product will include an "F" in third segment block.

Networking:

When installing the product on a monitored network, (ZONEWORKS, DATA, HIVE, DALI) simply insert the relevant Smart Node PCA.

Mounting Hole Dimensions:

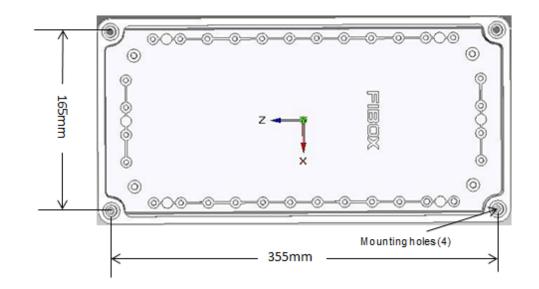

Testing:

When the Supalite unit is connected to the un-switched active, it must be allowed to charge the battery for at least 24 hours. The emergency lamp only illuminates during a power fail. Conduct the following tests:

- The emergency lamps must illuminate for at least 2 hours after disconnection from the mains. The results of all tests are required to be recorded in a service logbook, which is to be kept on-site at all times. If the unit fails to illuminate for the requisite time, remedial action must be taken to repair the situation and once completed, the unit must pass a subsequent test.
- Press and hold Test Button or switch Off Mains Supply, check that the emergency lamps are On.
- Release the Test Button or Switch On Mains Supply, check that the emergency lamps are Off (Non-maintained operation).

Trouble Shooting:

Below are a list of common problems and their possible causes.

Fault:	The Green LED Test Switch indicator is not illuminated.

Check: A.C. is connected and is turned on. Battery is connected Test Switch for damage.

Fault: Lamp does not illuminate in emergency mode.

- Check: A.C. is connected. Lamp is correctly inserted. Battery is connected
- Fault: Lamp illuminates in emergency mode, but only stays on for a short period.
- Check: Battery has been allowed to charge for at least 24 hours. Battery for damage.

Rated Emergency Lumen Output in accordance with AS2293.1, not applicable for –TH (theatre) version (refer to spacing tables for installation positions):

Refer to the Technical Label for classification information.

Caution:

On many building sites, power circuits may be cut off in an uncontrolled and repetitive basis during construction. As a result, any Exit & Emergency Units, on these circuits, will have their batteries discharged or "cycled". The battery in this fitting has been selected to give excellent long-life performance in a controlled AS2293 testing environment. Excessive battery cycling will reduce through-life performance and may lead to premature battery failure. Battery warranty claims, as a result of such abuse, are specifically EXCLUDED from Clevertronics warranty terms.

Warranty:

For Product Warranty information and Terms and Conditions of Sales please refer to our website http://clevertronics.com.au/terms-conditions-sale-australia-nz/