Clevertest and Clevertest Plus 💥

Refer to the supplementary operation guide supplied with the Product.

After Power ON, the Status LED on a Clevertest Plus enabled fitting will display a rapid Green or Red flashing for a period up to 2 minutes.

Maintained fittings (CLIFEM-PRO-WP-IPREM-xx-yy-zz) cannot be scanned with a camera using the Clevertest Plus App as the maintained light source interferes with the camera scanning function. To register the fitting manually enter the serial number from the QR code and visually read the test result and enter manually into Clevertest Plus App.

Zoneworks, HIVE and DATA Monitored Options

Fittings with part numbers -ZW, -HVG, -DATA are fitted with Zoneworks communications modules (nodes). These fittings are monitored using either Powerline Carrier Technology that utilize the power cable to provide data communication, RF transceiver modules operating in the ISM band or a dedicated data cable to/from data routers installed on a dedicated data trunk connected to a central Server (can also be connected via Ethernet/Internet/Fibre). Zoneworks software on the server is used to monitor, coordinate testing and collate test data from each fitting. Zoneworks Fittings can be commissioned by a single push of the test switch or by scanning the supplied barcode. The LED Test Switch indicator provides a multifunction indication of the status of the fitting during testing and nonreation:

Option	State	LED Operation
ZW, HVG, DATA	Commissioned	LED on Solid (Green)
ZW, DATA	Un-commissioned	Batt plugged-in: yellow 1s, green 1s
		Batt unplugged: red 1s, off 1s
HVG	Un-commissioned With network connectivity	Batt plugged-in: yellow 1s, green 1s
		Batt unplugged: red 1s, off 1s
HVG	Un-commissioned Without network connectivity	Batt plugged-in: yellow 250mS, green 250mS, yellow 250mS, green 250mS, green 1s
		Batt unplugged: red 250mS, off 250mS, red 250mS,off 250mS, off 1s
ZW, DATA	Emergency Light Test In Progress	LED flashes at yellow 5s , 0ff 1s
HVG	Emergency Light Test In Progress	LED flashes at yellow 1s, 0ff 1s

In the case of the DATA version a 2-way "figure 8" cable and terminal block facilitates the connection to the DATA network via a multi-drop bus (daisy chain connection). For further information of installation of a Zoneworks system, please refer to the Zoneworks Users Guide and Commissioning Guide (incl. DATA version)

DALI EM Option

Luminaires with part numbers having -DALI are fitted with DALI modules (nodes) that facilitate connection and integration to 3rd Party Lighting Control Systems. Before installing the -DALI fitting please confirm that the Lighting Control System has the capability to monitor DALI Emergency Luminaires. The -DALI fitting will be addressed and configured into the control system by the Lighting Control System Commissioning Technicians and not Clevertronics

State	LED Operation
Commissioned/ Un-commissioned	LED on Solid (Green)
Emergency Light Test in progress	LED flashes at 1s On (Yellow) & 1s Off
"IDENTIFY COMMAND"	Lamp and Status LED Flash for 30 seconds

A 2-way "figure 8" cable and terminal block facilitates the connection to the DALI network OR a 5/6way "structured wiring system" lead and plug facilitating the power and DALI connection. DALI connections are marked as Da Da.





CLP™ CLIFE-PRO-WP-IPREM

Remote Mount Weatherproof Emergency Luminaire Installation & Maintenance Instruction Leaflet



NOTE: Standard product codes with this symbol $\frac{1}{\sqrt{2}}$ are enabled with Clevertest Plus capability. Please refer to the operation guide supplied with the product for details.

Australia (Head Office) Website: <u>www.clevertronics.com.au</u>

Email: info@clevertronics.com.au Phone: +61 3 9559 2700 Fax: +61 3 9559 2799

UK OFFICE

Options:

Maintained

Tamperproof

Non-Maintained

Custom Option

Website: www.clevertronics.co.uk 362 Stockley Close West Drayton UB7 9BL Phone: 01895 430 255 CLIFEz-PRO-WP-IPREM-xx-yy-zz

z=M

z=Blank

vv=TP

77

Models:
Testing:CManual Testxx = BlankZoneworksxx = ZWZ/W DATAxx = DATA

Zoneworks HIVE xx = HVG DALI Registered. xx = DALI

Spare Parts:

1550230	Replacement Battery
1100698	Replacement Emergency LED Board
UKM02370070001	Replacement Emergency Driver

Important:


It is illegal for anyone, except for a licensed electrician to install or maintain this product. Before installation, ensure that the electricity supply has been switched off and isolated. Installation must be carried out in accordance with the relevant British Standards.

Installation:

This CLIFE-PRO Surface mount Weatherproof Emergency Luminaire can be installed on solid or T-BAR ceilings or used to replace an existing unit.

- Locate the installation position for each enclosure.
- Remove the enclosure covers.
- Pre-drill mounting holes per diagram below.
- Drill a hole in each enclosure to suit the cable gland or conduit to be used for LED cable entry.
- Drill a suitable hole in the Control Gear enclosure for power entry.
- Use suitable fixings to fasten each enclosure to the mounting surface.
- Route the interconnecting cable between the Control Gear and the LED lamp. Maximum length of
 interconnecting cable is 10m. For distances over 2 metres, an appropriate fire rated cable must be
 used.
- Connect the LED interconnect cable to the terminal block inside each enclosure. Be sure to match
 the colour code between the two terminal blocks.
- Connect the LED cable and battery to the control gear inside the control gear enclosure.
- All cable entry holes need to be suitably sealed to maintain the Ip rating of the product.
- Screw the covers to the enclosure bases.
- If the CTP capabilities are activated, please affix the CTP status label to a visible surface and Four Segment Marking on the product will include an "F" in third segment block.

Dimensions:

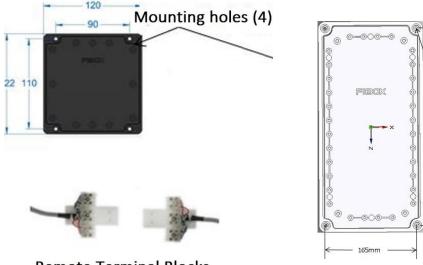

Remote Terminal Blocks

Note:

This luminaire (with reinforced insulation between control/LED terminal and AC supply) contains non-user replaceable light source and battery - to be replaced (if required, refer installation instructions for battery replacement) by Clevertronics service personnel/agents or a registered electrician.

Battery Replacement:

- 1. Prior to any work, isolate the power to the luminaire that requires battery replacement.
- 2. Open the Control Gear enclosure by removing the securing screws on the cover, support cover.
- 3. Remove the screws holding the gear tray, support the gear tray.
- 4. Remove the Battery Connector from the Emergency Driver.
- 5. Remove the battery from the gear tray by removing mounting screws.
- 6. Replace battery, re-install screws and connect to Emergency Driver.
- 7. Reinstall the Gear Tray.
- 8. Reinstall the Control Gear enclosure cover.

Testing Procedure:

When the unit is connected to the un-switched active, it must be allowed to charge the battery for at least 24 hours. The emergency lamp only illuminates during a power fail. Conduct the following tests:

- The emergency lamp must illuminate for at least 180 min after disconnection from the mains. If the unit fails to illuminate for the requisite time, remedial action must be taken to repair the situation and once completed, the unit must pass a subsequent test.
- Press and hold Test Button or switch Off Mains Supply, check that the emergency lamp is On.
- Release the Test Button or Switch On Mains Supply, check that the emergency lamp is Off (Nonmaintained operation).

Trouble Shooting:

Below are a list of common problems and their possible causes.

Fault: The Green LED Test Switch indicator is not illuminated.

Check: A.C. is connected and is turned on. Battery is connected Test Switch for damage.

Fault: Lamp does not illuminate in emergency mode.

Check: A.C. is connected. Lamp is correctly inserted. Battery is connected

Fault: Lamp illuminates in emergency mode, but only stays on for a short period.

Check: Battery has been allowed to charge for at least 24 hours. Battery for damage.

Caution:

On many building sites, power circuits may be cut off in an uncontrolled and repetitive basis during construction. As a result, any Exit & Emergency Units, on these circuits, will have their batteries discharged or "cycled". The Li-ion battery in the Exit & Emergency Unit has been selected to give excellent long life performance in a controlled IEC 60598-2-22 testing environment. Excessive battery cycling will reduce through-life performance and may lead to premature battery failure. Battery warranty claims, as a result of such abuse, are specifically EXCLUDED from Clevertronics warranty terms.

Warranty:

For Product Warranty information and Terms and Conditions of Sales please refer to our website https://clevertronics.co.uk/product-warranty-statement/