

Testing:

Once connected to the 240V mains supply, the unit must be allowed to charge the battery for at least 24 hours. Conduct the following tests:

- For the first test, the emergency lamp must remain illuminated for at least 2 hours after disconnection from the mains supply.
- Subsequent tests require the unit to illuminate for at least 90 minutes. The results of all tests are required to be recorded in a service logbook, which is to be kept on-site at all times. If the unit fails to remain illuminated for the requisite time, remedial action must be taken to repair the situation and once completed, the unit must pass a subsequent test. For more specific information, please refer to the current edition of the AS 2293.3 Standard.

LED Exit Maintenance:

Lamp Replacement:

- Use only the LED lamp strip recommended on the label inside the Exit fitting or this instruction.
- To replace the lamp, loosen the cover screws and remove, unplug lamp connector, remove nuts fastening lamp strip and remove, replace and reassemble.

Battery Replacement:

- Use only the battery recommended on the label inside the Exit fitting and on this instruction.
- Un-plug the lead from the Inverter pack. Remove the old battery and install the new one.
- Reconnect the battery cable to the inverter pack.

Trouble Shooting:

Below are a list of common problems and their possible causes.

Fault: The Green LED Test Switch indicator is not illuminated.

Check: A.C. is connected and is turned on.
Battery is connected
Test Switch for damage.

Fault: Lamp does not illuminate in emergency mode.

Check: A.C. is connected.
Lamp is correctly inserted.
Battery is connected

Fault: Lamp illuminates in emergency mode, but only stays on for a short period.

Check: Battery has been allowed to charge for at least 24 hours.
Battery for damage.

Rated Emergency Lumen Output in accordance with AS2293.1 (refer to spacing tables for installation positions):

C0=D6.3 C90=E3.2

Caution:

On many building sites, power circuits may be cut off in an uncontrolled and repetitive basis during construction. As a result, any Exit & Emergency Units, on these circuits, will have their batteries discharged or "cycled". The battery in this fitting has been selected to give excellent long life performance in a controlled AS2293 testing environment. Excessive battery cycling will reduce through-life performance and may lead to premature battery failure. Battery warranty claims, as a result of such abuse, are specifically EXCLUDED from Clevertronics warranty terms.

Warranty:

For Product Warranty information and Terms and Conditions of Sales please refer to our website <http://clevertronics.com.au/terms-conditions-sale-australia-nz/>



L10™ Jumbo LED Exit

Installation & Maintenance Instruction Leaflet



Victoria (Head Office & Manufacturing)

195 Chesterville Rd
Moorabbin VIC 3189
Phone: +61 3 9559 2700
Fax: +61 3 9559 2799

News South Wales

Phone: +61 2 8805 6400
Fax: +61 2 8805 6444

Queensland

Phone: +61 7 3442 9700
Fax: +61 7 3442 9777

South Australia/Northern Territory

Phone: +61 8 8301 8800
Fax: +61 8 8351 8286


Western Australia

Phone: +61 8 9248 3720
Fax: +61 8 9248 3725

New Zealand

Phone: +64 800 548 448


Designed in Australia to comply with the requirements of AS2293.3: 2005 and AS/NZS CISPR15: 2011.

NOTE: Standard product codes with this  symbol are enabled with Clevertest Plus capability. Please refer to the operation guide supplied with the product for details.

Models: LJELED-40-xx

Testing :

Manual Test	xx = Blank
Zoneworks	xx = ZW
Zoneworks DATA	xx = DATA
DALI Compatible	xx = DALI
Clevertest	xx = CT

(NOTE:-CT Products supplied with the Clevertest Plus Symbol  are activated with Clevertest PLUS capability. Please refer to the operation guide supplied with the product for details).

Spare Parts:

1530010	BATTERY:L10 3.3V 2.5AH. 200mm lead.Brkt
8002470	PCA: Duris E5 Strip for LJELED.CT10050-D1
LJELED-40-CKIT-110	Jumbo LED Exit, Control Kit, L10

Important:

It is illegal for anyone, except for a licensed electrician to install or maintain this product. Before installation, ensure that the electricity supply has been switched off and isolated. Installation must be carried out in accordance with the relevant Australian and International Standards.

Installation:

The Jumbo LED Exit can be Wall or Ceiling Mounted:

Wall Mounting (single sided)

- Remove one of the corner trim pieces
- Remove the back mounting plate.
- Determine power entry
- Position the mounting plate in the mounting position.
- Mark the 4 holes for mounting. Then install the appropriate fixings (not supplied).
- Reinstall the mounting plate to the fitting.
- Install the fitting on the mounting hardware, while routing the power cable through the access hole.
- Ensure connection of the grounding strap between the fitting and the back plate.
- Connect the 240VAC supply to the terminal block.

Ceiling Mounting (single or double sided)


- Remove one of the corner trim panels.
- Remove the diffuser panel.
- If converting to double-sided, remove the earth strap from the back plate before removing it.
- Determine power entry
- Position the fitting in the mounting position.
- Mark the mounting holes at the top of the fitting.
- Then install using the appropriate fixings (not supplied).
- Position the fitting while routing the power cable and attach to the surface as required.
- Connect the 240VAC supply to the terminal board.

If the CTP capabilities are activated please affix the CTP status Label to a visible surface.


Networking:

When installing the product on a monitored network, (ZONWORKS, DATA, DALI) simply insert the relevant Smart Node PCA.

Images and Dimensions:

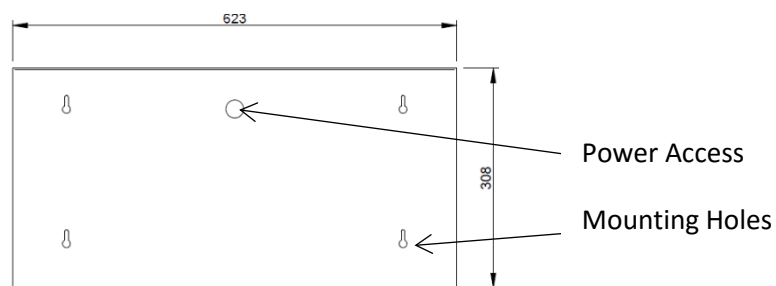

Wall Mounting Plate

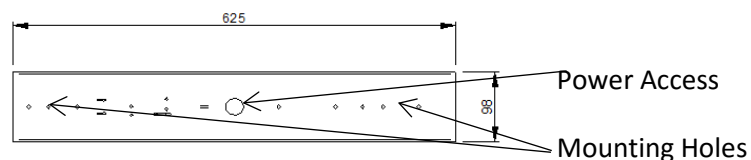

Ceiling Mounting Plate

Clevertronics Clevertest and Clevertest Plus

Refer to the supplementary operation guide supplied with the Product.

Zoneworks and DATA Monitored Options

Exits with part numbers LJELED*-ZW, LJELED*-DATA are fitted with Zoneworks communications modules (nodes). These fittings are monitored using either Powerline Carrier Technology that utilising the power cable to provide data communication or a dedicated data cable to/from data routers installed on a dedicated data trunk connected to a central Server (can also be connected via Ethernet/Internet/Fibre). Zoneworks software on the server is used to monitor, coordinate testing and collate test data from each Exit. Zoneworks Exit can be commissioned by a single push of the test switch, or scanning of the supplied barcode. The LED Test Switch indicator provides a multifunction indication of the status of the fitting during testing and normal operation:

State	LED Operation
Commissioned	LED on Solid (Green)
Un-commissioned	LED flashes at 0.5Hz (0.5s Green, 0.5s Yellow)
Emergency Light Test In Progress	LED flashes at 3s On (Yellow) & 0.5s Off

In the case of the DATA version a 2-way "figure 8" cable and terminal block facilitates the connection to the DATA network via a multi-drop bus (daisy chain connection). For further information of installation of a Zoneworks system, please refer to the Zoneworks Users Guide and Commissioning Guide (incl. DATA version)

DALI EM Option

Exits with part numbers LJELED-DALI are fitted with DALI modules (nodes) that facilitate connection and integration to 3rd Party Lighting Control Systems. Before installing the LJELED*-DALI please confirm that the Lighting Control System has the capability to monitor DALI Emergency Luminaires. The LJELED-DALI will be addressed and configured into the control system by the Lighting Control System Commissioning Technicians and not Clevertronics.

State	LED Operation
Commissioned/ Un-commissioned	LED on Solid (Green)
Emergency Light Test in progress	LED flashes at 1s On (Yellow) & 1s Off
"IDENTIFY COMMAND"	Fitting goes into emergency mode for 10 seconds

A 2-way "figure 8" cable and terminal block facilitates the connection to the DALI network. DALI connections are marked as Da Da.